

Scrunch

SOUND ABSORPTION COEFFICIENT ACCORDING TO ISO 354 AND ISO 11654

Measurement of sound absorption coefficient in a reverberation room




Report number:
14-41-M11
Date
2014-04-01

Frequency f [Hz]	Sound absorption coefficient	
	α_s	α_p
50	0.04	
63	0.05	0.05
80	0.01	
100	0.06	
125	0.07	0.10
160	0.14	
200	0.17	
250	0.30	0.30
315	0.42	
400	0.53	
500	0.68	0.65
630	0.81	
800	0.85	
1000	0.89	0.90
1250	0.91	
1600	0.93	
2000	0.92	0.90
2500	0.92	
3150	0.91	
4000	0.89	0.90
5000	0.93	

Client: Effect
 Manufacturer: Effect
 Product identification: Scrunch
 Description of test specimen: Scrunch utan fyllning, 30 paneler direkt på golv, typ A-montage.

Reverberation room volume: 200 m³
 Temperature: 16 °C (empty: 14 °C)
 Air humidity: 79.2% (empty: 74.6%)
 Air pressure: 101.3 kPa (empty: 101.3 kPa)
 Size of specimen: 10.31 m²

Measurement date: 2013-06-20
 Measured by: Pontus Thorsson

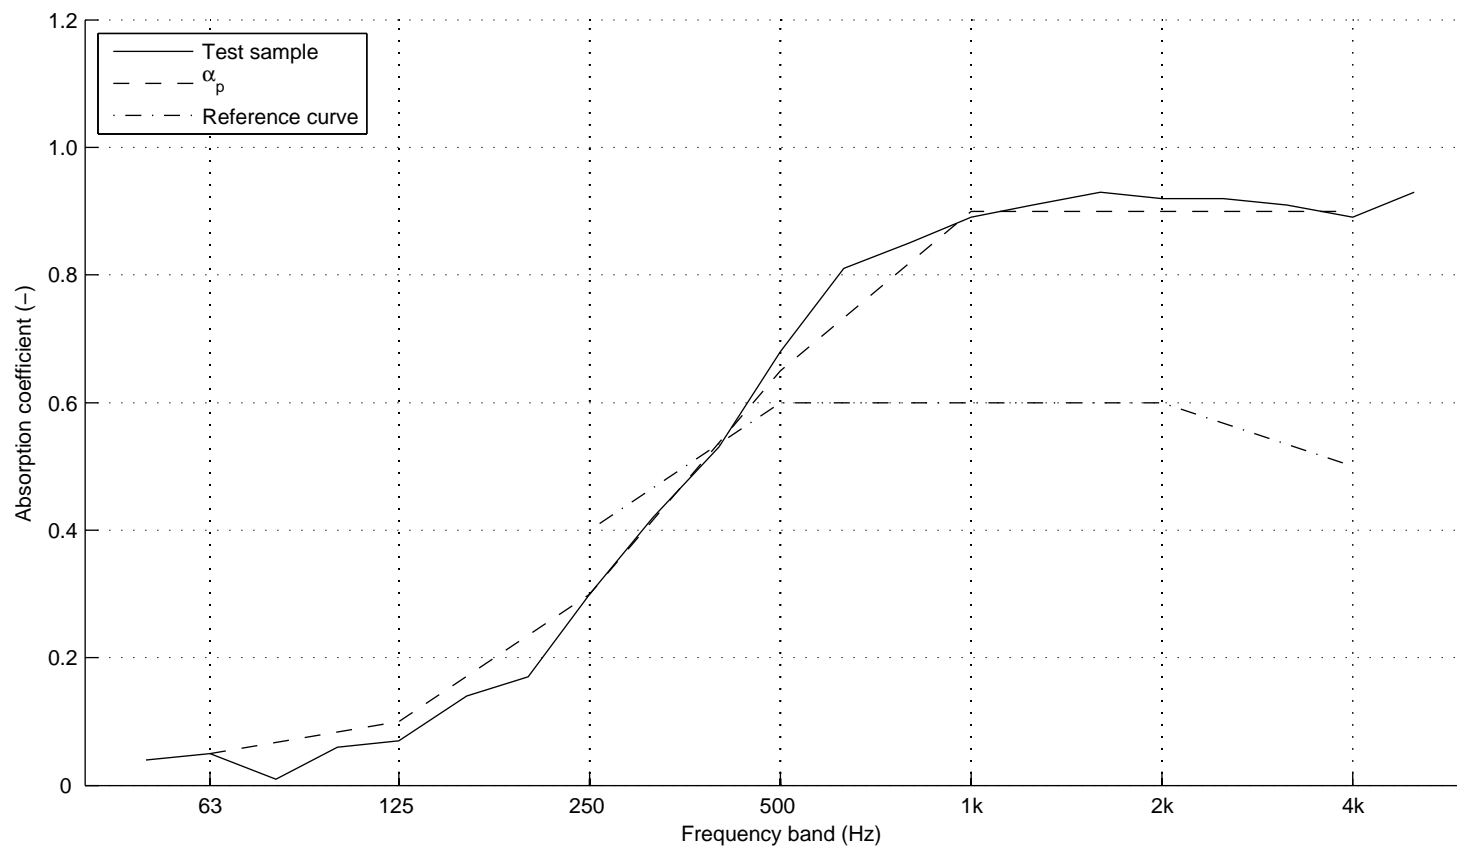

$\alpha_w = 0.60(\text{MH})$

Absorption class = C

Scrunch + basfill

SOUND ABSORPTION COEFFICIENT ACCORDING TO ISO 354 AND ISO 11654

Measurement of sound absorption coefficient in a reverberation room




Report number:
14-41-M10
Date
2014-04-01

Frequency f [Hz]	Sound absorption coefficient	
	α_s	α_p
50	0.00	
63	0.06	0.05
80	0.02	
100	0.08	
125	0.11	0.15
160	0.23	
200	0.35	
250	0.56	0.55
315	0.81	
400	0.94	
500	1.04	1.00
630	1.04	
800	1.02	
1000	1.03	1.00
1250	1.02	
1600	0.98	
2000	0.97	0.95
2500	0.94	
3150	0.93	
4000	0.91	0.95
5000	0.96	

Client: Effect
 Manufacturer: Effect
 Product identification: Scrunch + basfill
 Description of test specimen: Scrunch med fyllning, 30 paneler direkt på golv, typ A-montage.

Reverberation room volume: 200 m³
 Temperature: 16 °C (empty: 14 °C)
 Air humidity: 79 % (empty: 74.6%)
 Air pressure: 101.3 kPa (empty: 101.3 kPa)
 Size of specimen: 10.31 m²

Measurement date: 2013-06-20
 Measured by: Pontus Thorsson

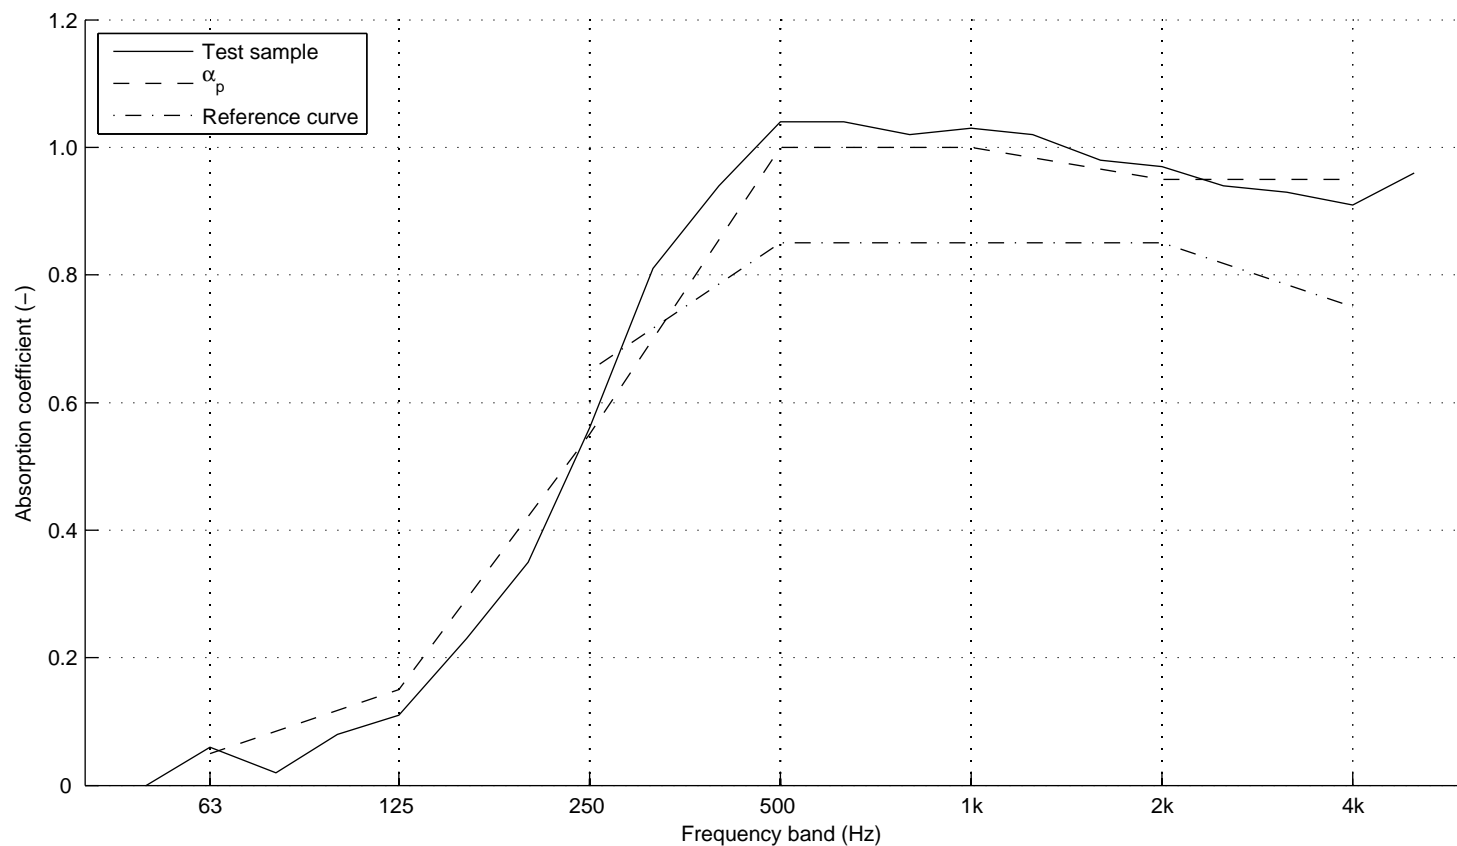

$\alpha_w = 0.85$

Absorption class = B